

Carmel Area Wd (Ca) - Facility Influent

Mpox virus in wastewater

Sample collection date

2023-05-07


NOT DETECTED

Virus concentration
(copies/day/person)
Below LOD

2023-05-02

NOT DETECTED

Virus concentration
(copies/day/person)
Below LOD

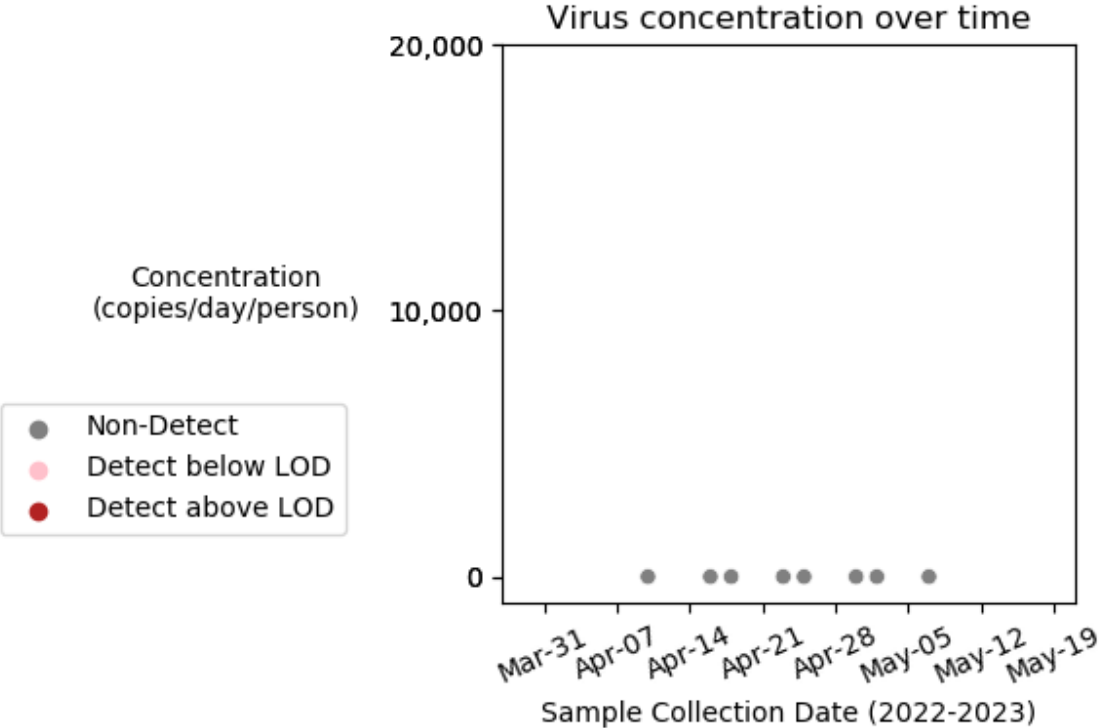

Note: Concentrations above 0 are considered detects. Concentrations below the limit of detection (LOD) are not reliable and should be interpreted with caution. The LOD is normalized to population flow-rate and changes by sample.